


DARWIN RIVER DAM PUMP STATION UPGRADE

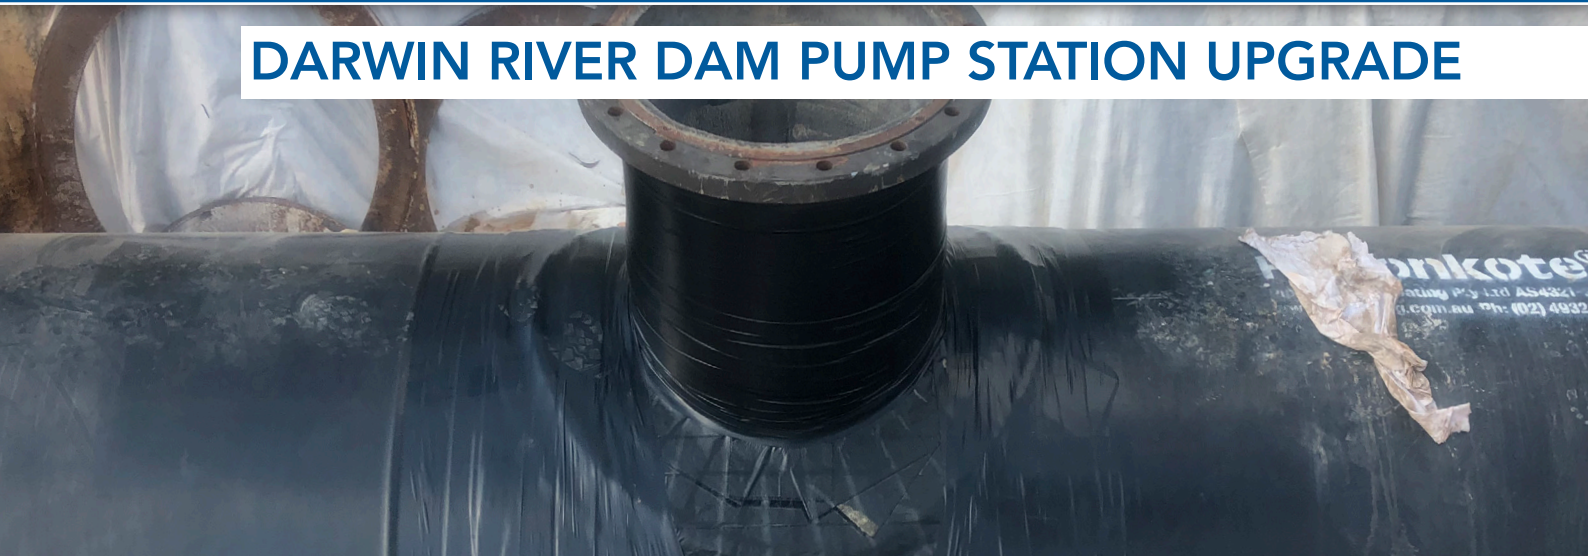

Premier Heat Shrink Sleeve 30 ST™ and Densopol 60™ Tape applied to the Darwin River pump station pipe.

PROJECT DATA

Location	Darwin River Dam, NT
Contractor	Welditright
Client	Power and Water
Products	Premier Heat Shrink Sleeve 30 ST™ and Densopol 60™ Tape
Date	October 2018
Ref No	B042

PROJECT DETAILS

Due to the ever increasing population in Darwin, an upgrade to the Darwin River Dam was a necessity. An extension to the pumping capabilities was required, so a duplicate pipe was installed.

The Pipe was a 1400mm diameter Fusionkote MSCL. The Power and Water approved Denso Premier Heat Shrink Sleeve 30 ST™ was selected for the Field joints, and Densopol 60™ Tape with Bitumen mastic strip was used for the scour valves and spool work.

These products were supplied by Rhino Industrial whom are a prime distributor in Darwin. Training in the application of both the Premier Heat Shrink Sleeves™ and the Densopol 60™ system was given to our new approved applicator, Welditright resulting in another successful application of a Denso Australia product.

DATE PUBLISHED: MAY 2020