



Engineering Specifications for **SeaShield™ Series 500** Steel, Concrete and Timber Pile Protection

1.0 Scope

- 1.1 This specification may be used for the materials and application of SeaShield™ Series 500 Pile Encapsulation System.
- 1.2 The engineer shall select appropriate sections of the specifications to ensure that the specification is comprehensive for specified work.

2.0 General Requirements

- 2.1 Contractor shall comply with all written recommendations of the manufacturer regarding application of the specified system.
- 2.2 The supplier of specified materials shall be Denso (Australia) Pty Ltd.

3.0 Materials

- 3.1 Fiberglass Jacket (SeaShield™ Fiber-Form Jacket)
- 3.1.1 The fiberglass jacket thickness shall be a standard 1/8" (3 mm) constructed of layers of woven roving and mat.
- 3.1.2 The jacket shall be translucent to provide visual inspection during the injection of the epoxy grout.
- 3.1.3 The jacket shall have minimum 1-1/4" (31.75 mm) injection ports spaced at intervals not to exceed five feet (1.5 m). To provide even distribution of the epoxy grout, the injection ports shall be placed on alternate sides (can be field installed by contractor).
- 3.1.4 The jackets shall have stand-offs adhered to the inside of the jacket to provide a minimum of a 3/8" (8 mm) annulus (or per project spec) between the pile and the jacket (can be field installed by contractor).
- 3.1.5 Spacers are also required at each port entry, placed approximately 75 mm from center of port. Three spacers per port are required.
- 3.1.6 The fiberglass jacket may be manufactured as either a single unit or as two pieces that shall be joined in the field. The jackets can be placed one above the other with the overlapping jacket having a molded open cavity to receive a bottom seal gasket.

- 3.1.7 The fiberglass jackets shall have the following properties:

Ultimate Tensile Strength	ASTM D638	15,000 PSI (103 MPa)
IZOD Impact Strength	ASTM D256	20 ft.-lb/in. (0.4 J/m)
Ultimate Tensile Strength	ASTM D638	16,000 PSI (110 MPa)
IZOD Impact Strength	ASTM D256	20 ft.-lb/in. (0.4 J/m)
Barcol Hardness	ASTM D2583	40
Water Absorption	ASTM D570	1% Max
UV Stability	ASTM G23	500 Hr. Pass

- 3.1.8 AUV inhibitor shall be included in the polyester resin.

3.2 Epoxy Grout

- 3.2.1 The epoxy grout shall be SeaShield™ 550 Epoxy Grout as supplied by Denso (Australia) Pty Ltd. The grout shall exhibit the following properties:

Physical Properties (unmixed) @ 77°F (25°C)

Component "A" (resin):	
Specific Gravity	1.13
Viscosity	600 cP
Component "B" (hardener):	
Specific Gravity	0.96
Viscosity	100 cP
Component "C" (aggregate):	
Specific Gravity	2.6
Free flowing powder	

Physical Properties (mixed) @ 77°F (25°C) with 3.5 parts Aggregate I to 1 part mixed "A" & "B"

Specific Gravity	1.88
Solids by Weight	100%

Physical Properties (mixed) @ 77°F (25°C) with 5 parts Aggregate I to 1 part mixed "A" & "B"

Specific Gravity	2.05
Solids by Weight	100%

The grout shall be pre-mixed prior to pumping. The 3.5:1 or 5:1 mixing ratio shall provide a free flowing grout which can be pumped without segregation and voids between the pile and jacket.

The pot life of the mixed grout is approx. 100 minutes at 77°F (25°C) and should not be pumped beyond this time frame. The pot life will be considerably less as the temperature increases.

3.2.2 The cured epoxy grout shall exhibit the following physical properties:

7 Day Compressive Strength	ASTM C579	10,500 PSI (72 MPa)
7 Day Tensile Strength	ASTM C307	2,200 PSI (15 MPa)
7 Day Bond/Shear Strength	ASTM C882	2,000 PSI (14 MPa)
Shrinkage After 7 Day Cure	ASTM C531	0.07%
Water Absorp. After 7 Day	ASTM C413	0.45% Max.

3.3 Adhesive

3.3.1 Denso FB30 Tape shall be used to adhere the fiberglass vertical seams.

4.0 Equipment

- 4.1 The epoxy grout shall be pre-mixed and pumped through a peristaltic pump or rotor stator pump. The equipment shall be capable of delivering mixed grout through hoses into the jackets at a rate 1 GPM (3.8 L/min) or greater. Contact equipment manufacture to make sure pump is capable of pumping epoxy grout.
- 4.2 Prior to using the pump, all lines shall be primed by circulating 1 gallon (3.8 liter) of the SeaShield™ Hose Lubricant.
- 4.3 The maximum hose length should be no longer than 50' (15 m).

5.0 Material Handling and Storage

5.1 Epoxy Grout Components

5.1.1 All liquid epoxy components shall be clearly marked with product name, component designation ("A" or "B"), manufactures name, batch number and ratio of component mixtures.

5.1.2 Epoxy components shall be stored in a covered, well ventilated space. The storage temperature shall not be less than 40°F (5°C) and no more than 120°F (49°C). It is recommended to store all components at 68°F to 86°F (20°C to 30°C) for 24 hours prior to use.

5.2 Fiberglass jackets on job site shall be stored in an area to prevent contamination and minimise distortion.

6.0 Surface Preparation

- 6.1 Prior to application, thoroughly clean and remove marine growth, oil, grease, rust and any other deleterious material which might prevent proper bonding between the pile and epoxy grout. Surface preparation shall be accomplished by grit blasting, power rotary tools or water blasting to provide

a surface profile necessary to meet the bond requirements.

7.0 Installation

7.1 Preparation of Fiberglass Jacket

7.1.1 The inside surface of the jacket shall have a roughened / textured surface.

7.1.2 All stand-offs shall be affixed to the jacket at 18" (450 mm) to 48" (1200 mm) intervals (depending on diameter size, length and thickness of jacket in the field) along entire length of jacket. If additional stand-offs are required in the field, SeaShield™ Stand-off Adhesive can be used to adhere them.

7.1.3 All longitudinal and transverse seams shall be sealed with SeaShield™ Adhesive Epoxy as described in Section 3.3.1 and fastened with 3/16" (4.8 mm) diameter stainless steel rivets or screws that shall not exceed 6" (150 mm) spacing.

7.1.4 The jacket shall be supported by temporary nylon straps or other means to assure that it will not move or distort during placement of epoxy grout.

7.1.5 A bottom seal shall be fitted on each jacket to prevent any epoxy grout from leaching out of the bottom of the jacket during the placement.

7.2 Epoxy Grout Placement

7.2.1 All three components shall be mixed thoroughly and shall be pumped through a minimum 1-1/4" (31.25 mm) hose ID with a suitable pump such as a peristaltic or rotor stator pump.

7.2.2 A bottom plug of 6" (150 mm) – 12" (300 mm) of epoxy grout shall first be pumped into the lowest injection port. The epoxy grout shall be allowed to cure before proceeding with subsequent lifts.

7.2.3 Once epoxy grout is cured the grout injection shall begin at the bottom injection port and proceed upwards. As the jacket is filled to each port, the lower port shall be capped off and repeated until the top of the jacket is reached. The injection process shall be continuous except when the injection hose is moved from port to port.

7.3 Completion

7.3.1 After the injection process is completed and the epoxy grout has cured, all temporary supports shall be removed.


7.3.2 The top of each fiberglass jacket may be finished with Denso FB30 Tape.



DENSO (AUSTRALIA) PTY LTD

77-95 National Boulevard
Campbellfield, VIC 3061
Tel: +61 3 9356 7600
Fax: +61 3 9356 7699
www.densoaustralia.com.au

A Member of Winn & Coales International

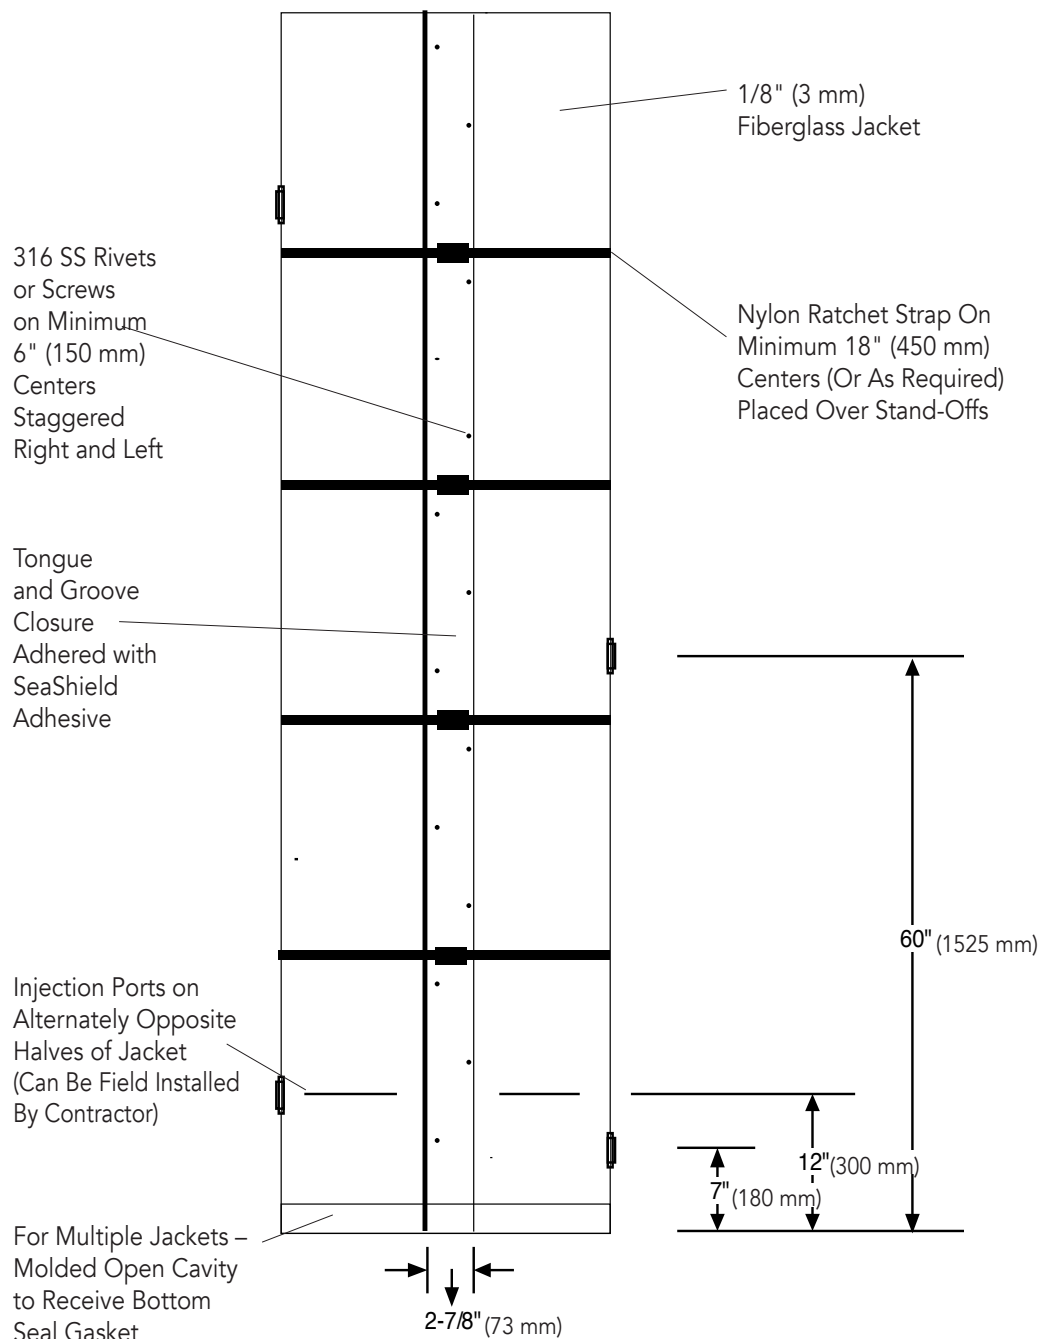


Elevation View

Note: All measurements are approximate and may vary due to diameter and length of jacket.

Sheet 1
(Not to Scale)

SeaShield™ Series 500
Pile Encapsulation




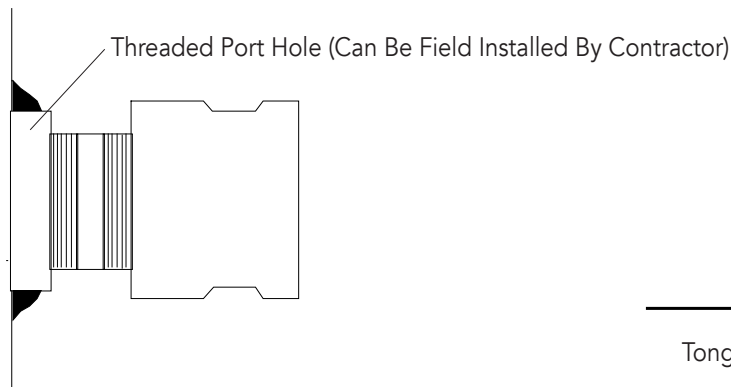

Injection Port Detail



Joint Option Details

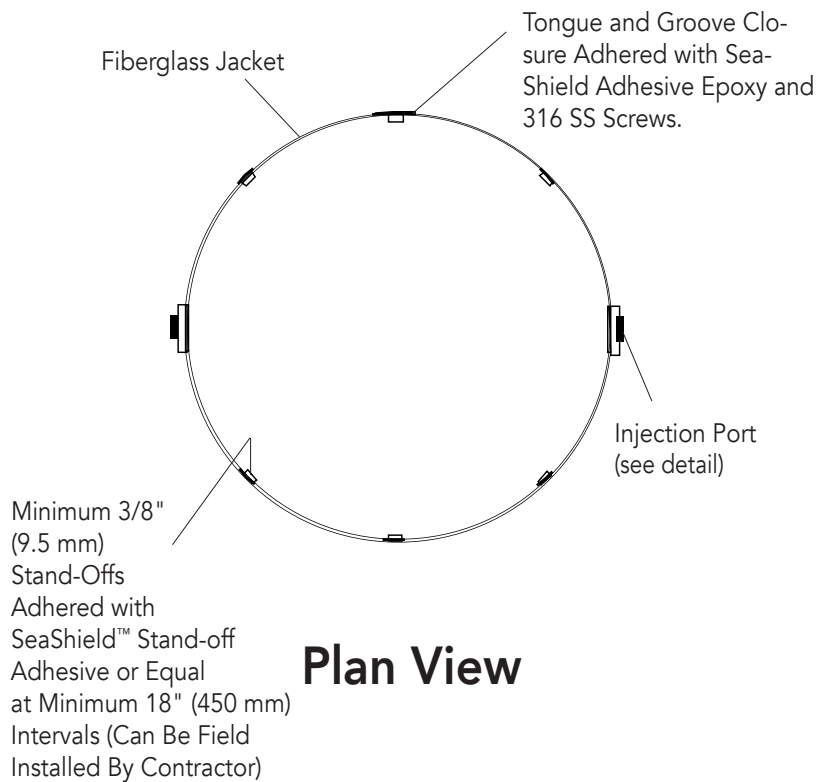

Plan View

Sheet 2
(Not to Scale)

**SeaShield™ Series 500
Pile Encapsulation**





Step 1

Position SeaShield Fiber-Form Jacket around pile and seal longitudinal seams.



Step 2

Affix bottom seal gasket with select strapping.



Step 3

Connect grout hose to lower injection port and pump SeaShield 550 Epoxy Grout. Visually check for leaks. Plug upper port(s) and pump grout until it reaches top of jacket. (Upper ports are used only if pumping from lower ports becomes difficult.)



Step 4

(Alternate Pumping Method)

Contractor may choose to inject approximately 6" (150 mm) of SeaShield 550 Epoxy Grout and let cure before moving grout hose to next higher port and pumping remainder of grout. Pumping would then continue until grout reaches top of jacket.


Cured SeaShield 550 Epoxy Grout

Sheet 3


(Not to Scale)

SeaShield™ Series 500 Grout Placement Sequence



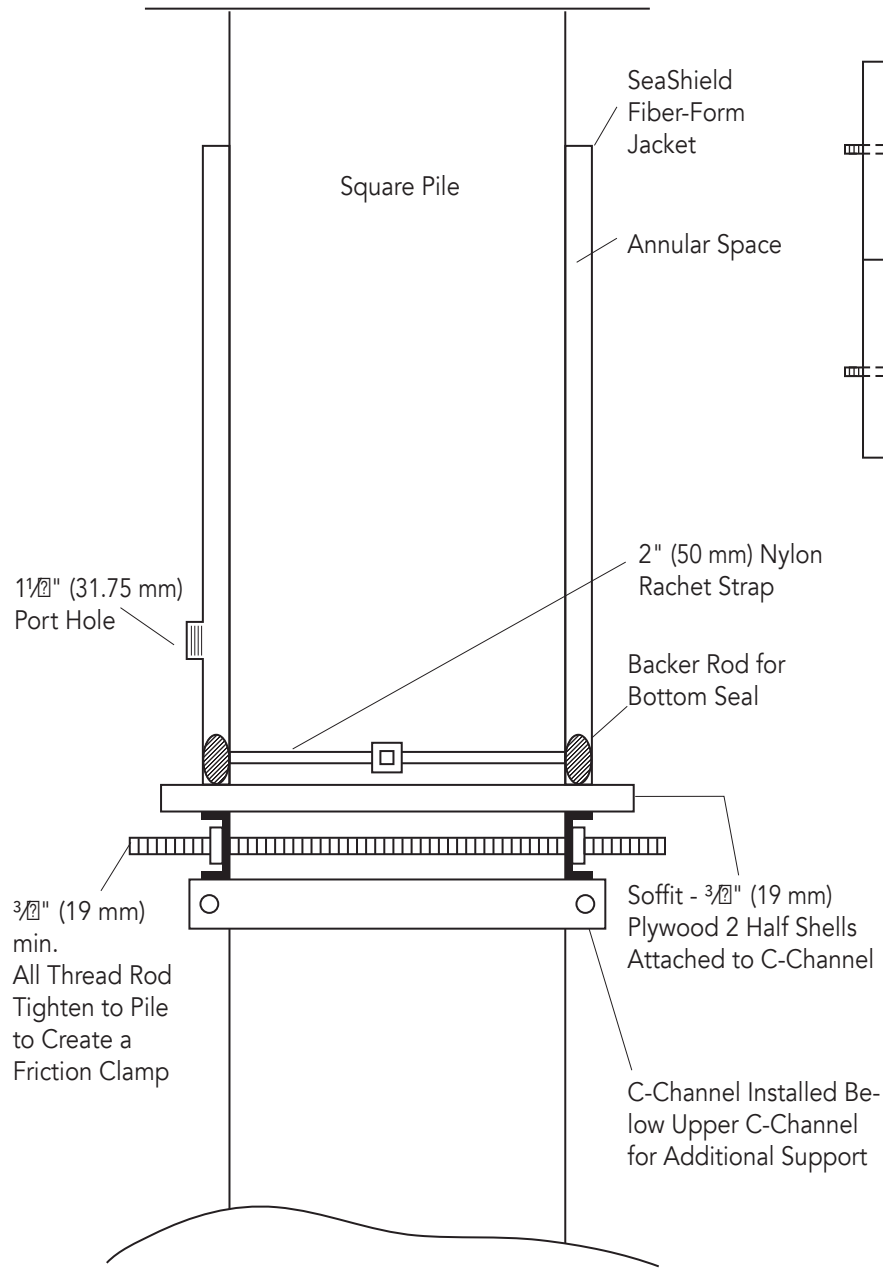

Elevation View

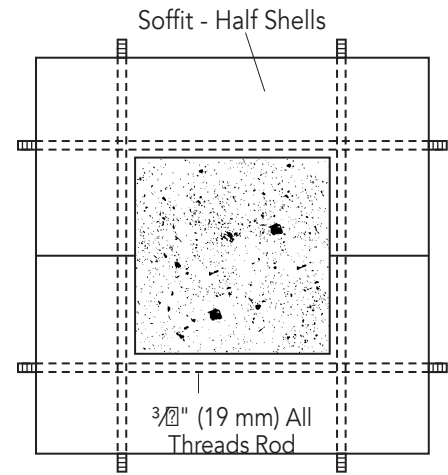

Plan View

Note: All measurements are approximate and may vary due to diameter and length of jacket.

Sheet 4
(Not to Scale)

SeaShield™ Series 500 Soffit Detail

